

ANALOGUE ADDRESSABLE SMOKE & HEAT DETECTORS

# XP95



- Digital Protocol
- Addressed by the patented XPERT Card
- Electronics Free Base



- 
- 
- 
- 
- **Alarm Flag for fast alarm reporting**
- **Alarm Address for fast location of alarm**
- **Automatic addressing with the patented XPERT card**
- **Electronics free base**
- **Slide-easy base**
- **Ease of installation**
- **Elegant design**

# XP95

## Analogue Addressable Smoke & Heat Detectors

The XP95 range of analogue addressable fire detectors is advanced in design, improved in performance and has unique features that benefit the installer and end user.

The range includes ionisation and optical smoke detectors, heat detectors and a multisensor detector. A manual call point, isolator, loop sounder and other compatible products are also available.

A unique, patented address mechanism, the XPERT card, ensures that the address data is stored in the base while keeping the base free of electronic parts that could be damaged during installation.

XP95 detectors have been carefully researched and developed by the Apollo design team and the range has undergone rigorous testing to ensure that it meets not only European and other standards but also the demands of today's high technology environments.



## XP95 SMOKE AND HEAT DETECTORS

The XP95 range has an elegant, unobtrusive design, finished in pure white polycarbonate



### ▲ XP95 Optical Detector

The XP95 optical smoke detector uses an internal pulsing LED and a photo-diode at an obtuse angle. In clear air conditions the photo-diode in the XP95 detector receives no light from the LED and produces a corresponding analogue signal. The signal increases when smoke enters the chamber and light is scattered onto the photo-diode. The signal is processed by the electronic circuitry and transmitted to the control equipment in exactly the same way as in the case of the ionisation smoke detector. The optical smoke detector is externally identical to the ionisation detector but is distinguished by having a clear indicator LED which emits red light when the detector is in alarm.

**Part no. 55000-600**

### ▼ XP95 Heat Detector

The XP95 heat detector is distinguishable from the smoke detectors by its low air-flow resistance case which allows good contact between the sensing thermistor and the surrounding air. The device monitors temperature by using a single thermistor network which provides a voltage output proportional to the external air temperature. The voltage signal is processed and transmitted to the control equipment in exactly the same way as in the case of the ionisation smoke detector. A heat detector for use in ambient safe temperatures of up to 50°C and which reaches the alarm level at 90°C is also available.

**Part no. 55000-400 (standard)  
55000-401 (high temperature)**



### ▲ XP95 Ionisation Smoke Detector

The air in the dual chambers of the XP95 ionisation smoke detector is irradiated to produce ions that travel to the positive and negative electrodes and hence create a current flow in the chambers. Smoke entering the outer chamber causes a drop in the current flow and an increase in the voltage measured at the junction between the outer and inner chambers. The analogue voltage signal produced in the sensing chamber is converted to a digital signal by the electronic circuitry and transmitted to the control equipment on interrogation. The micro-processor in the control equipment then compares the signal with the stored data and initiates a pre-alarm or fire alarm as smoke density increases. When the equipment determines that a fire condition exists, it instructs the detector to switch on its indicator LED and the pre-planned alarm routine is initiated.

**Part no. 55000-500**




#### ▼ XP95 Multisensor Detector

The XP95 Multisensor detector combines inputs from optical and heat sensors and processes them using a sophisticated algorithm. It is designed to be sensitive to a wide range of fires and may be used in place of an ionisation detector in many instances. The detector's construction is similar to that of the optical detector but uses a different lid and optical mouldings to accommodate the thermistor temperature sensor.

*For more information, please refer to Apollo publication PP1039.*

**Part no. 55000-885**

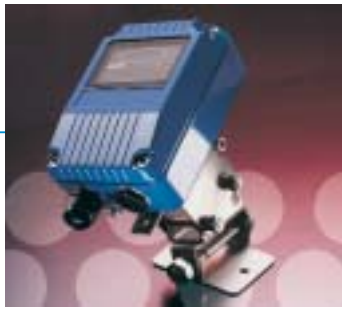

#### ▲ XP95 Flame Detector

The XP95 flame detector is designed for use in areas where flaming fires may be expected and is sensitive to low-frequency, flickering infra-red radiation emitted by flames during combustion.

The XP95 flame detector is loop-powered and requires no external supply. It communicates with the control panel using either the XP95 or Discovery protocol.

**Part no. 55000-280**

#### ▼ Intrinsically Safe Detector

XP95 Intrinsically Safe detectors include all the benefits of the standard XP95 range, but are developed specifically for use in hazardous areas. This range includes ionisation and optical smoke detectors, heat detectors and manual call points, BASEEFA approved to E EX ia IIC T5.

XP95 IS detectors, manual call points and short circuit isolators are approved by a number of marine classification societies. These include the Americal Bureau of Shipping (ABS), Bureau Veritas (BV), Det Norske Veritas (DNV), Germanischer Lloyd, Lloyd's Register of Shipping, and the Maritime and Coastguard Agency (MCA).

*For more information, please refer to Apollo publications PP1094 and PP1095.*



#### Marine (not illustrated)

XP95 detectors, manual call points and short circuit isolators are approved by a number of marine classification societies. These include the Americal Bureau of Shipping (ABS), Bureau Veritas (BV), Det Norske Veritas (DNV), Germanischer Lloyd, Lloyd's Register of Shipping, and the Maritime and Coastguard Agency (MCA).

*For more information, please see Apollo publication PP1099.*

#### ▼ Sounders

There are two types of loop-powered sounder available, one ceiling-mounted for fitting with detectors; one stand-alone.

*For more information, please refer to Apollo publications PP2082 for XP95 100dB Loop Sounder or PP2031 for XP95 Loop Sounder.*

**Part nos.**

**45681-261 85dB Sounder (sounder only)**

**45681-262 Sounder for use with isolating base**

**55000-259 Sounder with white cap**

**55000-260 Sounder with red cap**

**55000-261 100dB Loop Sounder**



#### ▲ Interfaces

A comprehensive range of interface units is available.

*See Apollo publication PP2025.*

#### XP95 Isolator

Isolators are designed to protect the XP95 loop in the event of a short circuit fault. They divide a loop of fire detectors and ancillary devices into groups of 20 as a rule, so that, in the event of a short circuit, no more than 20 devices will be inoperable. The XP95 isolator has particularly low non-isolating resistance.

**Part no. 55000-720**




#### ▲ XP95 Beam Detector

The XP95 beam detector has been designed to protect large, open spaces such as museums, churches, warehouses and factories. It consists of three main parts: the transmitter, which projects a beam of infra-red light, the receiver, which registers the light and produces an electrical signal, and the interface, which processes the signal and generates alarm or fault signals.

The XP95 beam detector is loop-powered and requires no separate 24V supply, eliminating the need for additional equipment and saving installation time.

*For more information, please refer to Apollo publication, PP2078*

**Part no. 55000-265**

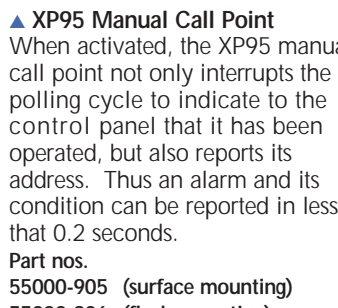

#### ▲ XP95 Manual Call Point

When activated, the XP95 manual call point not only interrupts the polling cycle to indicate to the control panel that it has been operated, but also reports its address. Thus an alarm and its condition can be reported in less than 0.2 seconds.

**Part nos.**

**55000-905 (surface mounting)**

**55000-906 (flush mounting)**

#### ▲ Isolating Base

The XP95 20D Isolating base senses and isolates short circuit faults on XP95 loops and spurs. The base is loop powered, polarity sensitive and accepts the XPERT card to set the associated device address.

*For more information, please refer to the Apollo publication PP2039.*

**Part no. 45681-321**

#### Bases

A wide range of bases is available.

*For more information, please refer to the Apollo publication PP1089.*

# XP95

## XP95 Specification Summary

Typical at 23C and 24VDC unless otherwise stated	XP95 Multisensor	XP95 Isolating base	XP95 Ionisation	XP95 Optical	XP95 Temperature	XP95 High Temp.	XP95 MCP	XP95 Isolator
Device Part No.	55000-885	45681-321	55000-500	55000-600	55000-400	55000-401	55000-905/6	55000-720
Base Part No.	45681-210	N/A	45681-210	45681-210	45681-210	45681-210	N/A	45681-211
Size of Device in Base Height x Diameter (mm)	58x100	24x100	50x100	50x100	50x100	50x100	Surface 87x87x52 Flush 87x87x31	32x100
Supply Voltage	17-28VDC	17-28VDC	17-28VDC	17-28VDC	17-28VDC	17-28VDC	17-28VDC	17-28VDC
Quiescent Current	500µA	43µA	280µA	340µA	250µA	250µA	230µA	45µA
Normal Surge Current (Synchronised to ADC Operation)	1mA	N/A	1mA	1mA	1mA	1mA	1mA	N/A
Alarm Indication	Red LED	N/A	Red LED	Clear LED	Red LED	Red LED	Red LED	N/A
Alarm LED Current	4mA	N/A	2mA	4mA	2mA	2mA	2mA	N/A
Normal Operating Temperature (no icing)	-20 to +60°C	-20 to +60°C	-20 to +60°C	-20 to +60°C	-20 to +70°C	-20 to +70°C	-20 to +60°C	-20 to +70°C
Humidity (no condensation)	0-95% RH	0-95% RH	0-95% RH	0-95% RH	0-95% RH	0-95% RH	0-95% RH	0-95% RH
Max wind (continuous)	N/A	N/A	10m/s	N/A	N/A	N/A	N/A	N/A

### XP95 Mounting base and XPERT Card

The base has been designed to enable detectors to be plugged in without any need for force and to have a "one-way-only" fit. By means of a unique, patented "XPERT card" the address information is held in the base while keeping the base entirely free of electronic parts. This coded plastic card is inserted into the base on commissioning, so that the

address remains the same, no matter how often the detector is replaced by similar devices for servicing purposes.

**Part No. 45681-210**

### Automatic Addressing with the patented XPERT Card

Depending on the combination of pips removed, switches in the detector head are operated to produce the correct address, when the detector head is inserted.



XP95 smoke and heat detectors have been approved by a number of approvals bodies throughout the world including LPCB in the UK and VdS in Germany. They comply with the EMC directive 89/336/EEC and are CE marked. XP95A detectors are UL listed.



INVESTOR IN PEOPLE



Quality Systems Certificate No 010  
Assessed to ISO 9001



36 Brookside Road, Havant, Hampshire PO9 1JR, UK. Tel: +44 (0)23 9249 2412. Fax: +44 (0)23 9249 2754.  
Email: sales@apollo-fire.co.uk Website: www.apollo-fire.co.uk

Apollo GmbH, Gneisenaustr IIA, 33330 Gütersloh, Germany. Tel: +49 5241 33060. Fax: +49 5241 330629  
Air Products and Controls Inc., 1749 E Highwood, Pontiac, MI 48340, USA. Tel: +1 248 332 3900. Fax: +1 248 332 8807